



ENVIRONMENTAL  
CLIMATE CONTROL  
EQUIPMENT & SOLUTIONS



Thermodynamic double flow dehumidifier



[www.ett-hvac.com](http://www.ett-hvac.com)

## CONTENTS

▪ General description.....	3
▪ Unit description.....	4
▪ Operating principles.....	5
▪ Detailed composition of the unit.....	7
▪ Thalasso and Hydrotherapy option.....	10
▪ Main options.....	11
<b>Technical features</b>	
▪ DESHU XP+ 107.....	12
▪ DESHU XP+ 109 - 110 - 125.....	14
▪ DESHU XP+ 160 - 185.....	16
▪ DESHU XP+ 210 - 225.....	18
▪ DESHU XP+ 260 - 285.....	20
<b>Dimensions and connections</b>	
▪ DESHU XP+ 107.....	13
▪ DESHU XP+ 109 - 110 - 125.....	15
▪ DESHU XP+ 160 - 185.....	17
▪ DESHU XP+ 210 - 225.....	19
▪ DESHU XP+ 260 - 285.....	21
<b>Aeraulic arrangements</b>	
▪ Aeraulic arrangements.....	22
<b>Auxiliaries</b>	
▪ Electric coils.....	23
▪ Hot water coil.....	24
<b>Condenser</b>	
▪ Water condenser.....	26
<b>Connections</b>	
▪ Hot water coil & water condenser.....	27
<b>Fan sound level</b>	
▪ Supply air side/Exhaust air side.....	28
▪ Fresh air inlet/Return air side.....	29
<b>Installation accessories</b>	
▪ Installation on feet.....	30

# General description

The **ETT** packaged unit, delivered ready to operate, is made entirely of aluminium (frame and casing), making it particularly resistant to corrosion (20-year anti-corrosion guarantee). The **ETT** equipment can be installed either on a roof or on the ground.

**EcoDesign favors DECONSTRUCTION:** the recyclability of **ETT** units is 98% (Reuse rate and recycling for a basic ULTI+ R32 21).

Our technical choices have several impacts on the environment

## • Legal and regulatory framework :

- Pursuant to the Environmental Code and Directive 2008/98/EC on waste, considering clause 26 : "The polluter-pays principle is a guiding principle at European and international levels. The waste producer and the waste holder should manage the waste in a way that guarantees a high level of protection of the environment and human health.", », ETT is a member of "Ecologic" for France.

- In accordance with articles 5.3, 5.4 and 11 of Regulation (EC) No 303/2008, ETT holds a certificate of capability to handle refrigerants no. 637.

## • Aluminium : a good choice for the planet !

- Aluminium is 100% recyclable indefinitely.  
- Recycling ensures more than 30% of aluminium needs.

EcoLogic

## • Consumable waste, efficient management :

- Filtration: ETT units incorporate "Eco-Design" air filters (frame selective sorting - grid - media)

## • Low polluting ETT manufacturing process:

- Selective sorting by raw materials, all waste is recovered, 80% of which is recycled.  
- No paint on casings, no use of solvent.

## • ETT certifications

- **ISO 14001** certification: Environmental management system

- **ISO 9001** certification: Our quality organization is the subject of AFAQ certificate n° 1994/2016f. Each unit is checked and tested at the factory before delivery and is subject to a control certificate.

- **CSR assessment** : Quality of CSR management system - **Corporate Social Responsibility**




## We placed ease of operation at the heart of our units design:

- A separate **technical section** facilitates unit control and maintenance and allows measurement and adjustment during operation.
- The **BEST PLC**, specially designed for this application, ensures, thanks to its very high flexibility, optimum operation of the **ETT** unit and favors the user-friendly local or remote communication via remote display, PC or BMS.



Moreover, each unit is delivered with an **EC certificate of conformity** and complies with the standards listed below:

- Machinery Directive 2006/42/EC - Operator's safety
- Low Voltage Directive (LVD) 2014/35/EU
- Electromagnetic Compatibility (EMC) Directive 2014/30/EU
- Regulation (EU) 2016/426 – Gas appliances
- EN 60204-1 - Safety of machinery – Electrical equipment
- EN 378-2 standard: 2017 – Safety and environmental requirements
- PED Directive 2014/68/EU (according to articles 2.10, 2.11, 3.4, 5a and 5d of Annex 1) - Pressure equipment



# Unit description

With a wealth of eXPerience in the field of dehumidification in France and Abroad, ETT offers you a new generation of DEHUMIDIFIERS... The DESHU HPE+ becomes **DESHU XP+**.

The **DESHU XP+** is an improved unit with increased capacities and new options to meet the dehumidification needs of swimming pools and thalassotherapy centres.

## Eco-design filtration

Low pressure drop level.

**NEW!** Fouling analogue control.

Standard ISO ePM10 50% (M5), ISO ePM1 50% (F7), ISO ePM1 80% (F9) (optional bag filter).

## Thermodynamic coils and heat recuperator

**NEW!** Optimised heat exchangers with reduced refrigerant charge

Protected coil with vinyl coated fins

**NEW!** Electronic expansion valves

## Fans


**NEW!** Specific protection for salty and sulphurous environments (H2+S)  
Analogue Flow Controller (AFC), communicating, direct drive, electronically commutated motor « EC », optimal efficiency and low noise level.

## Connected components

Optimum unit operation.

Possible connection to myETTvision communication platform.

**NEW!** Remote box for communication outside the engine room.

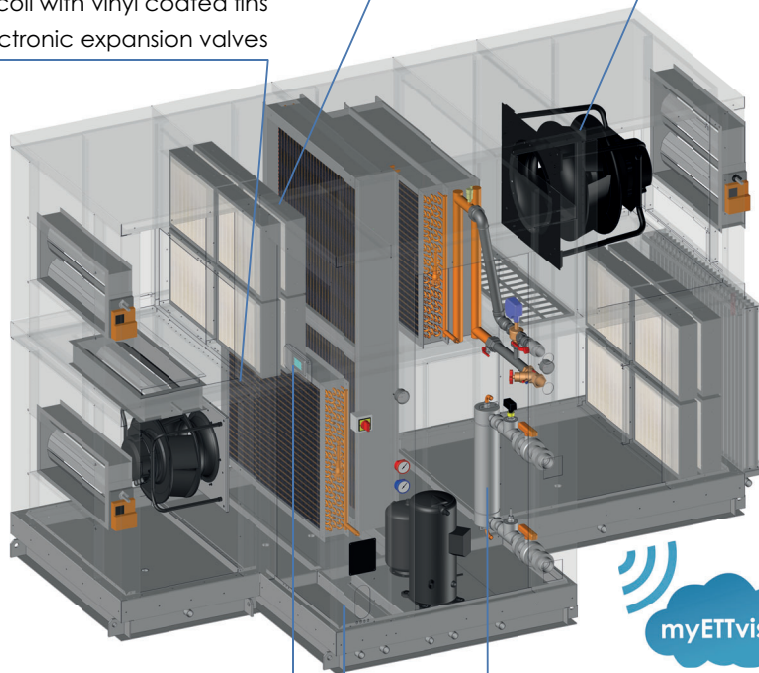

## New generation PLC with display

**NEW!** Control for optimal operation

Possibility to compare the outdoor specific humidity in Free Cooling and dehumidification modes

New ETT Control Box display

Electrical board separated from the technical room

Standard phase controller

## Thalassotherapy options **NEW!**

Varnishing of pipes and brazes

Titanium insulated water exchanger

Coils protection with heresite coating

Salt filter and fine filter (ISO ePM1 50% (F7) or ISO ePM1 80% (F9)) on return

## Aluminium frame-casing assembly

Optimised tightness and heat insulation.  
Reduced weight, for new and refurbish projects.

20-year guarantee against corrosion frame - casing

Depressurization of the technical compartment to avoid any pollution by the stale air during recovery **NEW!**

Compact casing that can be placed against a wall


# Operating principles

## Dehumidification is ensured by the heat pump cooling cycle coupled with a heat pipe.

The heat pipe recovers heat without external energy, which allows significant energy savings and compressors' size reduction by 30 to 50%, thus reducing power consumption.

Exhaust air is dried up firstly through a pre-cooling process on the heat pipe and then through final cooling on the evaporator. Heat is then transferred to the supply air side, firstly to the other part of the heat pipe and secondly to the air condenser, to heat the dehumidified air.

Due to latent heat recovery and energy supplied by the compressors, the supply air temperature at condenser outlet is higher than the air temperature at unit inlet (room temperature).

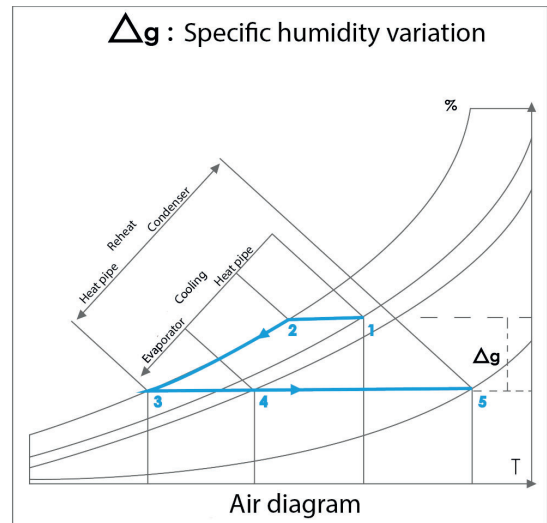

## Adaptive control:

### For temperate climates:

- > During **periods of vacancy**, regulation favors thermodynamics in recycling and will launch a cycle of dechlorination one hour before opening to the public.
- > **During occupation**, dehumidification will be ensured by fresh air, in order to ensure comfort to the occupants, thermodynamics will then operate as a heat pump in order to enhance the heat on the air or on the water.

### For hot and tropical climates:

- > **Comparison of the outdoor specific humidity with the return specific humidity**, thermodynamic discards if derived from the outdoor specific humidity.
- > Authorization of Free Cooling if conditions are favourable.
- > Thermodynamic cooling


## Vacancy Mode :



**In vacancy mode**, thermodynamic dehumidification with air recycling and recovery from the air or water in the pools.

The air flow can be lowered to reduce energy consumption.

## Dechlorination Mode :

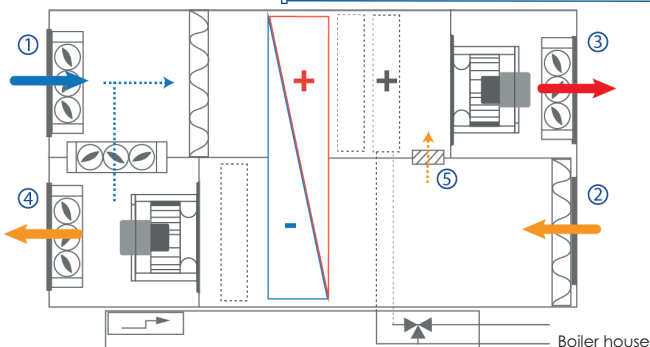


**Dechlorination mode** prior to occupancy mode to clean indoor air.

This mode can also be activated manually.

- ① Fresh air ② Return air ③ Supply air ④ Exhaust air ⑤ Supply air bypass

# Operating principles


## Occupancy mode - Dehumidification :

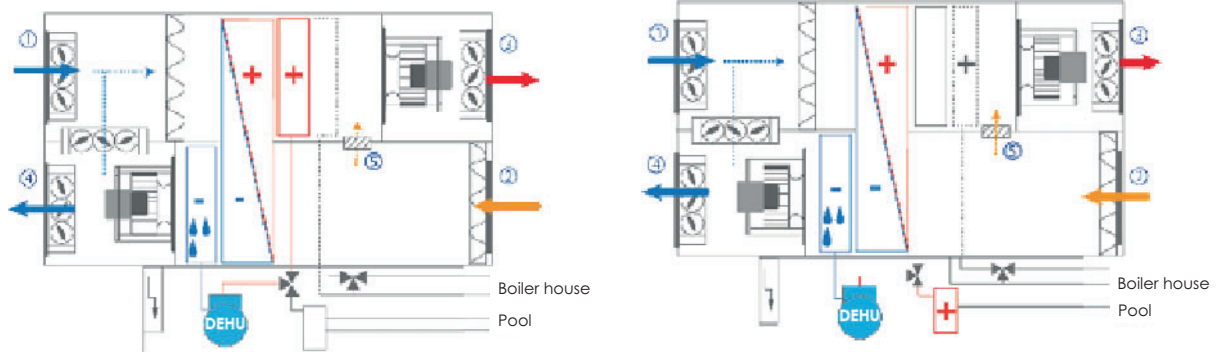

**In occupancy mode**, dehumidification is carried out by modulating the fresh air. The heat is then recovered by the action of the heat pipe and then the heat pump, and recovered from the air or water.

**For hot and tropical climates**, the outdoor specific humidity is measured to control the fresh air register.

## Refresh mode:

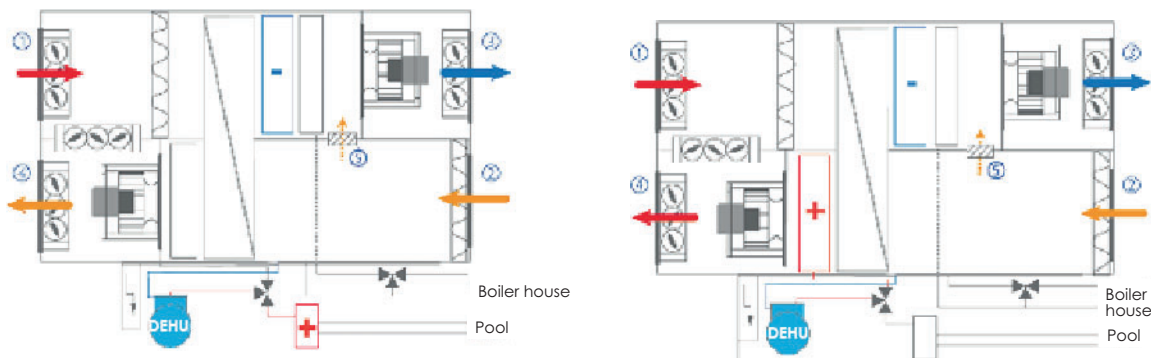

Regulation favours cooling by Free Cooling.


If the external conditions are not favourable, then cooling will be carried out by the thermodynamic system,

Heat can also be recovered from water.

- ① Fresh air ② Return air ③ Supply air ④ Exhaust air ⑤ Supply air bypass



# Detailed components of the unit

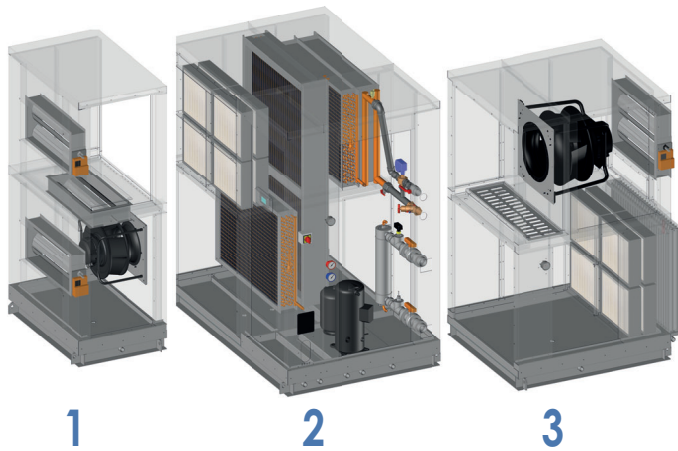

## The ETT packaged unit comprises 3 different sections:

- 1 The exhaust air section ensures dehumidification and energy recovery.
- 2 The separate technical section houses the refrigeration components, the electrical board and the control components.
- 3 The supply air section ensures air change and room air treatment.

## Aluminium frame and casing assembly :

- **Rigid, compact** and lightweight packaged unit, perfectly weather-resistant, with a 20-year anti corrosion guarantee on casing.
- **Watertight floor** with drainage outlets around the unit, connected to rubber traps.
- **Full aluminium** casing (AG3).
- **Access through large removable panels.** Panels are closed with square locks. Doors tightness is ensured by a flexible gasket under compression, providing ideal elasticity day after day.
- **Double skin internal soundproofing and heat insulation** of the walls using 50 mm thick glass wool classified M0/A2s1d0, protected by a 13/10 thick aluminium sheet for mechanical protection and ease of maintenance.
- **Floor soundproofing and heat insulation** using 80 mm M0/A2s1d0-rated rock wool with double skin.
- 3-register **mixing box** consisting of a fresh air register with bird proof grid, a discharge exhaust air register and a mixing air register, all motorised, to ensure the desired proportions and optimise the Free Cooling phases. Registers have extruded aluminium blades with low pressure drop thanks to the plane wing profile. The register frame is made of aluminium.

# Detailed components of the unit

## Aeraulics assembly :

- Easily removable **98 mm thick Eco-design filtration** (supply and exhaust) - ISO ePM10 50% (M5) efficiency in pleated media with fouling controlled by the regulator.
- • High performance plug fan on supply and exhaust air sections to avoid losses due to pulley-belt transmissions thus improving energy efficiency. The fans will be standard H2S protected for application in aggressive atmospheres such as thalassotherapy applications
- **Last generation internal fans (High Energy Performance):**
  - ✓ **Direct transmission** (gains in maintenance, reliability and consumption),
  - ✓ Fitted **with a variable speed "EC" electronically commutated motor** combined with an Analogue Flow Controller - AFC (easier to commission),
  - ✓ Communicating for real time operation adjustment.
  - ✓ Integrated Soft Starter system for reduced starting current and soft start (textile ducting)

## Energy and thermodynamic assembly:

- **Refrigeration circuits** compliant with European directive on pressure equipment (PED 2014/68/EU).
- R410A **refrigerant**.
- **A fixed heat pipe** with copper tubes and aluminium fins, with high recovery capacity and sized to optimise the heat pump's output. The heat pipe recovers heat from the extracted air and transfers it to the fresh air side of the second half of the heat pipe. This process uses no energy. The heat pipe is protected by a vinyl coating.
- **Direct expansion heat exchangers, with copper tubes and aluminium fins**, with high heat exchange capacity optimised by a thermostatic expansion valve, selected for an air speed of less than 2.5 m/s to avoid any risk of condensate being carried away. Coils are oversized in order to achieve the highest possible COP. Direct expansion exchangers are protected with vinyl coating.
- **2 electronic expansion valves** for increased optimised heat exchanger operation and rapid stabilisation of the thermodynamic system
- Anti-acid **filter drier**.
- **HP pressure switch**






# Detailed components of the unit

## Electrical assembly:

- **Electrical board** compliant with French standards NF EN C 15-100 and NF EN 60204-01, including:
  - ✓ **An ETT PLC** with display.
  - ✓ **A power switch** with lockable external handle for full load cut-off. Standard universal cable connection. Optional copper/aluminium connection boxes.
  - ✓ A 400-230-24 V **transformer** for control and regulation circuits.
  - ✓ **A fault summary** with pending dry contact on terminal.
  - ✓ **Numbered terminal blocks** with disconnectable terminals for all transfers or remote controls.
  - ✓ **A terminal block** for compressor load shedding.
  - ✓ **Internal wiring** fully numbered at both ends with numbered rings.
  - ✓ An **Ik3 breaking capacity** of 10 kA basic.
  - ✓ All components **protected** by circuit breakers.
  - ✓ **A phase controller**

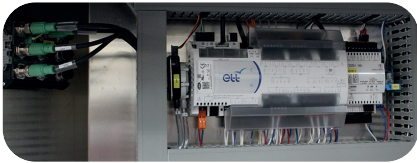

## Additional heat package:

- ✓ Heating auxiliary (electric heater or hot water coil) specially designed for the project.

## Control assembly:

- **NTC-type temperature sensors.** Their accuracy and reliability have been tested and validated both at the factory and on site.
- **One or more BEST PLCs** (Building Energy Saving Technology) especially developed by ETT for this range of units. Programs are updated annually in order to add functions requested for some applications and to optimise units power consumption.
- Native IP MODBUS communication protocol (BACnet IP optional)

The microprocessor, memory and PLC size are adapted to the chosen applications and options by integrating a program set-up in the factory out of 160 possible configurations.

The PLC is in a plastic box that guarantees a high mechanical protection and reduces electrostatic shock threats.

### The PLC performs the following functions, among others:

- ✓ **On/Off by remote contact** or vacancy contact.
- ✓ **Occupancy/Vacancy mode** according to programmed schedule (2 time slots per day).

- ✓ **Fault summary** by dry contact for report to customer system.
- ✓ **Management of safety devices** (frost protection thermostat, smoke detector, HP pressure switch, etc.) and faults.
- ✓ **Control of supply and extract airflow** according to a progressive law based on indoor temperature and humidity setpoints.
- ✓ **Optimisation** and equalisation of compressor operating time.
- ✓ **Measurement, indication and adaptation of the supply/extraction airflow rates** according to the machine's operating modes.
- ✓ **Management of night-time energy consumption** with limited ventilation
- ✓ **Fault history** in literal form (no code) with indication of time and outdoor temperature.
- ✓ **Recording of unit, compressor and auxiliaries operating times.**
- ✓ **Control of the unit's operating points**, whatever the external environment, enabling comfort to be managed for users, taking into account the relationship between energy efficiency and the protection of the building.




# Thalasso and Spa option



**Herasite protection** on the entire battery and support frame

**Fan H2+S** with a coating to resist to salt spray. For use in humidity-saturated environments.

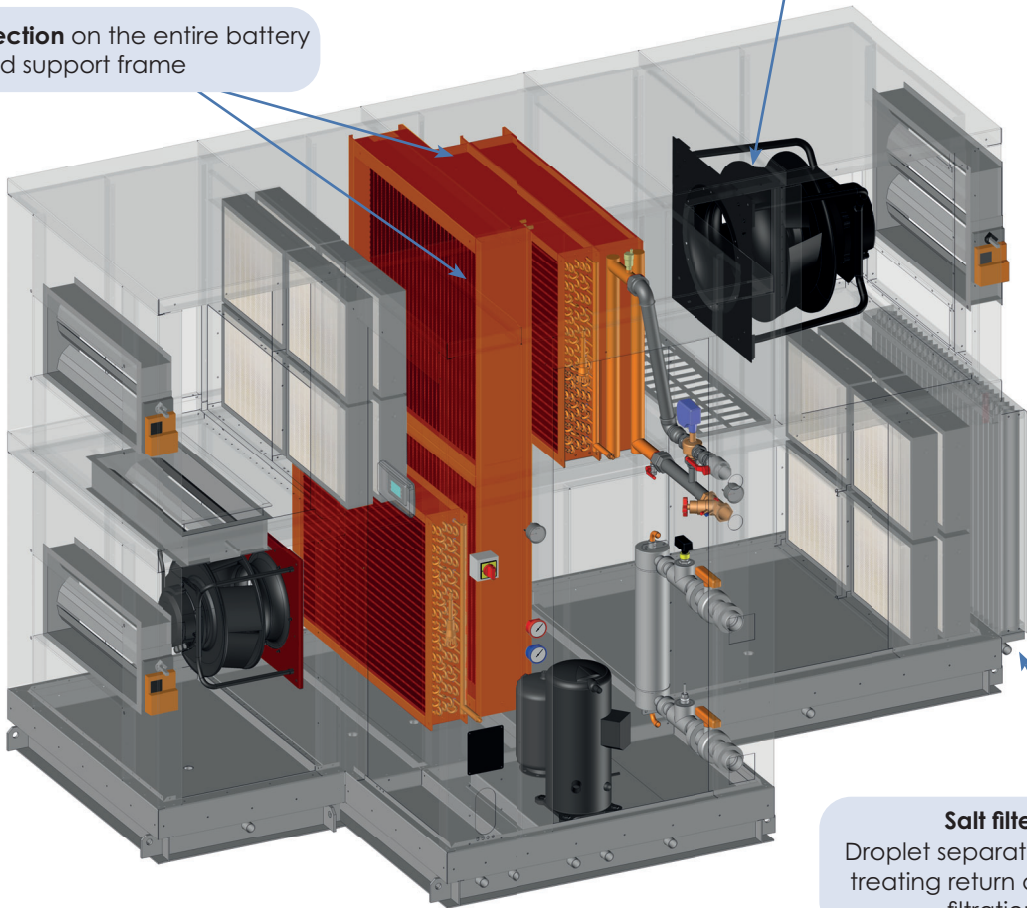

**Salt filter**  
Droplet separator for pre-treating return air before filtration



**Double varnishing** of copper piping and brazing of refrigeration circuit components



# Main options

---

## Frame - Casing

- Motorised external supply air register (CH 38 - 2006/42/EC Directive)
- Packaged or 3-block unit

---

## Acoustics

- Acoustic insulation of the technical compartment with STOPFLAM foam
- Acoustic insulation of the fresh air cowl
- Compressors acoustic jackets

---

## Aeraulics

- High performance plug fans with H2S protective coating
- High flow fans
- Pressure gauge per filtration cell
- Filters fouling analogue control (FFAC)
- Actuating smoke detector with battery back-up
- ISO ePM10 50% (M5), ISO ePM1 50% (F7) or ISO ePM1 80% (F9) opacimetric filters 98 mm thick
- ISO ePM1 80% (F9) polydihedral opacimetric filters in polypropylene 292 mm thick for supply air only

---

## Thermodynamics

- HP and LP pressure gauge
- Electronic expansion valves
- Cooling with reverse cycle

---

## Thermal exchangers

- 3-stage electric heater
- Triac
- Hot water coil with analogue anti-freeze thermostat
- 3-way progressive valve mounted on hot water coil
- Pre-assembled shut-off valve + balancing valve

---

## Installation

- aluminium feet 200, 400 or 600 mm

---

## Electrics and communication

- Unit global energy metering
- Phase checker
- Humidity sensor on fresh air with comparison of specific humidity (recommended with cooling by cycle inversion)
- Software licence for BacNet IP protocol
- IT earthing system compatibility
- ETT Control box Remote touch display
- MyETTvision remote communication platform

---

## Recovery

- 316 L stainless steel insulated water condenser with 3-way valve and self-resetting water flow controller (only during chlorine water treatment)
- CPVC stop valve on water-cooled condenser

---

## Thalassotherapy and spa option

- Heat pipe with heresite coating
- Hot water coil with heresite coating
- Thermodynamic coils with heresite coating
- Double coating of pipes
- Aluminium salt filters on return
- Titanium insulated water condenser with 3-way refrigerant valve and self-resetting water flow controller
- Fine filters (ISO ePM1 50% (F7) or ISO ePM1 80% (F9)) for return and supply air

	DESIGNATION	Unit	107
<b>SPECIFICATIONS</b>	Rated supply air flow rate	m <sup>3</sup> /h	6000
	Min./Max. supply air flow rate	m <sup>3</sup> /h	3400/7100
	Treated air flow rate dehumidification	m <sup>3</sup> /h	4000
	Min./Max. treated air flow rate	m <sup>3</sup> /h	3400/4600
	Dehumidification capacity on a heating base 100% recycling <sup>(2)</sup>	kg/h	17.4
	Dehumidification capacity on a heating base with 20% of FA <sup>(2)</sup>	kg/h	26.1
	Dehumidification capacity on a heating base with 50% of FA <sup>(2)</sup>	kg/h	39.1
	Thermodynamic COP on a heating base <sup>(2)</sup>	kW/kW	5.13
	Overall efficiency on a heating base <sup>(2)(4)</sup>	kW/kW	6.67
	Heat pipe recovery capacity <sup>(2)</sup>	kW	6.8
	Air-cooled condenser recovery capacity <sup>(2)</sup>	kW	23.6
	Water-cooled condenser recovery capacity on pool water <sup>(4)</sup>	kW	24.8
	Recommended total water flow rate per water-cooled condenser recovery pool <sup>(4)</sup>	m <sup>3</sup> /h	4.5
	Pressure drop, with water-cooled condenser for recovery on pool water <sup>(4)</sup>	mWC	1
	Hot water coil maximum capacity, 80/60°C, exchanger inlet at 10°C	kW	68.3
	Total cooling capacity in cooling cycle <sup>(3)</sup>	kW	19.4
Number of independent refrigeration circuits	U	1	
<b>ELECTRICAL CONNECTION</b>	Unit total electrical power installed (standard) <sup>(1)</sup>	kW	13.3
	Total rated/starting current (standard) <sup>(1)</sup>	A	18.1/84.2
<b>FANS</b>	<b>SUPPLY AIR</b>		
	Number of fans (standard)	u	1
	Installed power	kW	2.97
	Power absorbed at 300 Pa available for recovery	kW	1.93
	<b>EXHAUST AIR</b>		
	Number of fans	u	1
	Installed power	kW	2.94
	Absorbed/Installed electrical power with 300 Pa available for return air	kW	1.91
	Average sound pressure level at 10 m ref. 2x10 <sup>-5</sup> in free field	dB(A)	47.1
	<b>GENERAL</b>	Filters efficiency	
Weight of block A (without options)		kg	130
Weight of block B (without options)		kg	400
Weight of block C (without options)		kg	190
ETT unit weight without options		kg	720

(1) Excluding electrical resistors.

(2) Conditions: Recovery 28°C/65% RH; exterior -7°C/95% RH.


(3) Conditions: Recovery 29°C/70% RH; exterior +35°C/40% RH.

(4) Conditions: 28°C pool water; 28°C/65% RH return air


(5) ISO ePM10 50% (M5) / ISO ePM1 50% (F7), / ISO ePM1 80% (F9)

(6) 3-phase power supply 400V - 50Hz + earth without neutral.


### Front view:

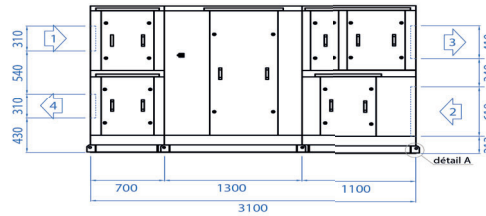

### Top view (fresh air/supply air):

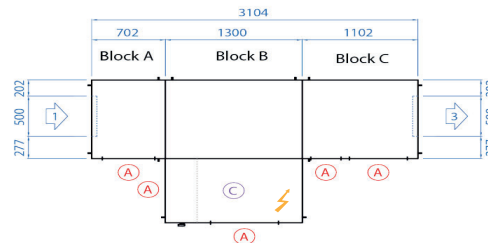

### Top view (return air/exhaust air):

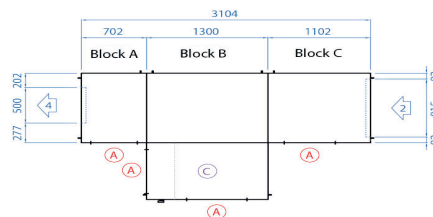

- ① Fresh air
- ② Return air
- ③ Supply air
- ④ Exhaust air
- Ⓐ Access
- ⚡ Power supply
- Ⓒ Technical section

	Length	Width	Height
Dimensions of assembled casing (mm)	3100	1775	1840
Overall dimensions for transport (Packaged unit) (mm)	3170	1852	1840
Overall dimensions for transport - BLOCK A (mm)	733	1045	1840
Overall dimensions for transport - BLOCK B (mm)	1852	1370	1840
Overall dimensions for transport - BLOCK C (mm)	1135	1045	1840

**Note:** Provide 200 mm clearance (minimum) below the unit for condensate traps connection.

	DESIGNATION	Unit	109	110	125
<b>SPECIFICATIONS</b>	Rated supply air flow rate	<b>m³/h</b>	7500	8250	9750
	Min./Max. supply air flow rate	<b>m³/h</b>	4000/9000	4600/10250	5800/11500
	Treated air flow rate dehumidification	<b>m³/h</b>	5000	5500	6500
	Min./Max. treated air flow rate	<b>m³/h</b>	4000/5800	4600/6300	5800/7300
	Dehumidification capacity on a heating base 100% recycling <sup>(2)</sup>	<b>kg/h</b>	23.2	26.3	30.2
	Dehumidification capacity on a heating base with 20% of FA <sup>(2)</sup>	<b>kg/h</b>	33.8	37.8	43.9
	Dehumidification capacity on a heating base with 50% of FA <sup>(2)</sup>	<b>kg/h</b>	49.6	55.0	64.5
	Thermodynamic COP on a heating base <sup>(2)</sup>	<b>kW/kW</b>	5.74	5.52	5.34
	Overall efficiency on a heating base <sup>(2)(6)</sup>	<b>kW/kW</b>	8.01	8.19	7.96
	Heat pipe recovery capacity <sup>(2)</sup>	<b>kW</b>	9.6	10.8	12.4
	Air-cooled condenser recovery capacity <sup>(2)</sup>	<b>kW</b>	31	35.3	40.6
	Water-cooled condenser recovery capacity on pool water <sup>(4)</sup>	<b>kW</b>	32.3	36.8	42.2
	Recommended total water flow rate per water-cooled condenser recovery pool <sup>(4)</sup>	<b>m³/h</b>	5.8	6.6	7.5
	Pressure drop, with water-cooled condenser for recovery on pool water <sup>(4)</sup>	<b>mWC</b>	1.6	2	2.5
	Hot water coil maximum capacity, 80/60°C, exchanger inlet at 10°C	<b>kW</b>	91.2	97.5	111.3
	Total cooling capacity in cooling cycle <sup>(3)</sup>	<b>kW</b>	25.9	29.1	33.5
Number of independent refrigeration circuits	<b>U</b>	1	1	1	
<b>ELECTRICAL CONNECTION</b>	Unit total electrical power installed (standard) <sup>(1)</sup>	<b>kW</b>	14.9	16.3	19.0
	Total rated/starting current (standard) <sup>(1)</sup>	<b>A</b>	20.3/110.8	23.7/137.8	27.6/150.4
<b>FANS</b>	<b>SUPPLY AIR</b>				
	Number of fans (standard)	<b>u</b>	1	1	1
	Installed power	<b>kW</b>	3.4	3.4	4.45
	Power absorbed at 300 Pa available for recovery	<b>kW</b>	2.21	2.21	2.89
	<b>EXHAUST AIR</b>				
	Number of fans	<b>u</b>	1	1	1
	Installed power	<b>kW</b>	2.94	2.97	2.97
	Absorbed/Installed electrical power with 300 Pa available for return air	<b>kW</b>	1.91	1.93	1.93
	Average sound pressure level at 10 m ref. 2x10 <sup>-5</sup> in free field	<b>dB(A)</b>	46.7	44.4	45.4
	<b>GENERAL</b>	Filters efficiency		M5 / F7 / F9 <sup>(5)</sup>	M5 / F7 / F9 <sup>(5)</sup>
Weight of block A (without options)		<b>kg</b>	175	175	175
Weight of block B (without options)		<b>kg</b>	600	600	600
Weight of block C (without options)		<b>kg</b>	275	275	275
ETT unit weight without options		<b>kg</b>	1050	1050	1050

(1) Excluding electrical resistors.

(2) Conditions: Recovery 28°C/65% RH; exterior -7°C/95% RH.

(3) Conditions: Recovery 29°C/70% RH; exterior +35°C/40% RH.


(4) Conditions: 28°C pool water; 28°C/65% RH return air

(5) ISO ePM10 50% (M5) / ISO ePM1 50% (F7), / ISO ePM1 80% (F9)


(6) Three-phase power supply 400V-50Hz + earth without neutral.




## Front view:

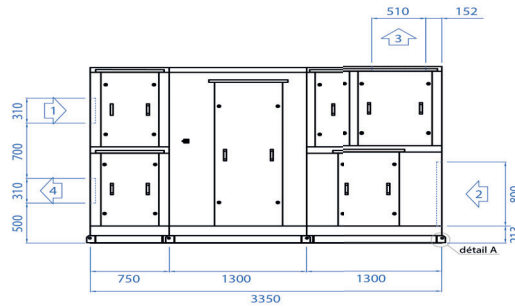

## Top view (fresh air/supply air):

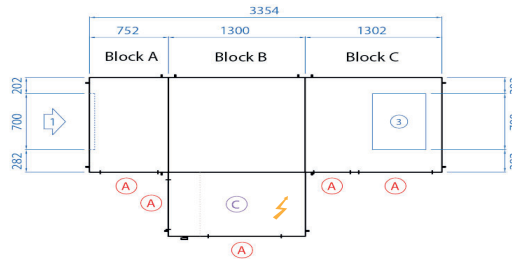

## Top view (return air/exhaust air):

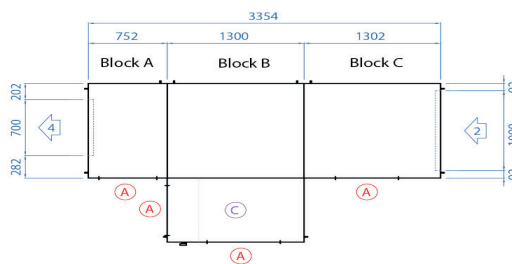

- ① Fresh air
- ② Return air
- ③ Supply air
- ④ Exhaust air
- Ⓐ Access
- ⚡ Power supply
- Ⓒ Technical section

	Length	Width	Height
Dimensions of assembled casing (mm)	3350	1980	2200
Overall dimensions for transport (Packaged unit) (mm)	3420	2057	2200
Overall dimensions for transport - BLOCK A (mm)	1250	785	2200
Overall dimensions for transport - BLOCK B (mm)	2057	1370	2200
Overall dimensions for transport - BLOCK C (mm)	1335	1250	2200

**Note:** Provide 200 mm clearance (minimum) below the unit for condensate siphons connection.

DESIGNATION		Unit	160	185
SPECIFICATIONS	Rated supply air flow rate	m <sup>3</sup> /h	12000	15000
	Min./Max. supply air flow rate	m <sup>3</sup> /h	7100/16500	8300/18000
	Treated air flow rate dehumidification	m <sup>3</sup> /h	8000	10000
	Min./Max. treated air flow rate	m <sup>3</sup> /h	7100/10500	8300/12000
	Dehumidification capacity on a heating base 100% recycling <sup>(2)</sup>	kg/h	41.5	46.3
	Dehumidification capacity on a heating base with 20% of FA <sup>(2)</sup>	kg/h	57.5	67.4
	Dehumidification capacity on a heating base with 50% of FA <sup>(2)</sup>	kg/h	81.6	99.2
	Thermodynamic COP on a heating base <sup>(2)</sup>	kW/kW	5.65	5.78
	Overall efficiency on a heating base <sup>(2)(6)</sup>	kW/kW	8.13	8.47
	Heat pipe recovery capacity <sup>(2)</sup>	kW	16	19.4
	Air-cooled condenser recovery capacity <sup>(2)</sup>	kW	54.8	61.8
	Water-cooled condenser recovery capacity on pool water <sup>(4)</sup>	kW	55.6	63.4
	Recommended total water flow rate per water-cooled condenser recovery pool <sup>(4)</sup>	m <sup>3</sup> /h	8.1	9.3
	Pressure drop, with water-cooled condenser for recovery on pool water <sup>(4)</sup>	mWC	2.8	3.6
	Hot water coil maximum capacity, 80/60°C, exchanger inlet at 10°C	kW	145.5	172.8
Total cooling capacity in cooling cycle <sup>(3)</sup>	kW	45.3	51.6	
Number of independent refrigeration circuits	U	1	1	
ELECTRICAL CONNECTION	Unit total electrical power installed (standard) <sup>(1)</sup>	kW	25.4	28.4
	Total rated/starting current (standard) <sup>(1)</sup>	A	35.7/173.6	40.5/214.2
FANS	<b>SUPPLY AIR</b>			
	Number of fans (standard)	u	2	2
	Installed power	kW	6.8	6.8
	Power absorbed at 300 Pa available for recovery	kW	4.42	4.42
	<b>EXHAUST AIR</b>			
	Number of fans	u	1	1
	Installed power	kW	3.40	4.45
	Absorbed/Installed electrical power with 300 Pa available for return air	kW	2.21	2.89
Average sound pressure level at 10 m ref. 2x10 <sup>-5</sup> in free field	dB(A)	45.3	46.3	
GENERAL	Filters efficiency		M5 / F7 / F9 <sup>(5)</sup>	M5 / F7 / F9 <sup>(5)</sup>
	Weight of block A (without options)	kg	265	265
	Weight of block B (without options)	kg	795	795
	Weight of block C (without options)	kg	365	365
	ETT unit weight without options	kg	1425	1425

(1) Excluding electrical resistors.

(2) Conditions: Recovery 28°C/65% RH; exterior -7°C/95% RH.


(3) Conditions: Recovery 29°C/70% RH; exterior +35°C/40% RH.

(4) Conditions: 28°C pool water; 28°C/65% RH return air


(5) ISO ePM10 50% (M5) / ISO ePM1 50% (F7), / ISO ePM1 80% (F9)

(6) Three-phase power supply 400V-50Hz + earth without neutral.


## Front view:

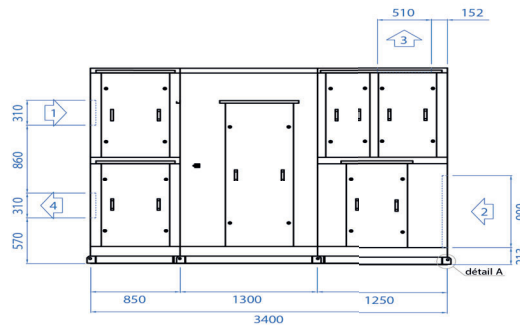

## Top view (fresh air/supply air):

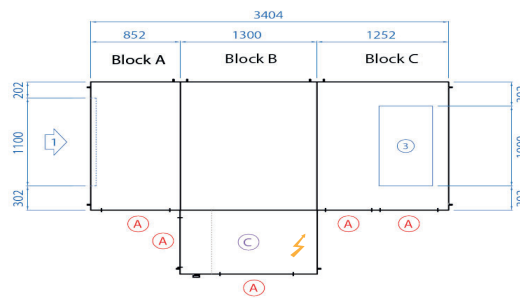

## Top view (return air/exhaust air):

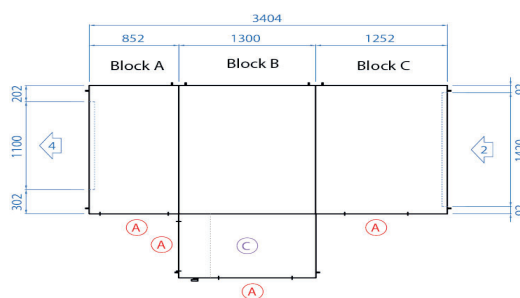

- ① Fresh air
- ② Return air
- ③ Supply air
- ④ Exhaust air
- Ⓐ Access
- ⚡ Power supply
- Ⓒ Technical section

	Length	Width	Height
Dimensions of assembled casing (mm)	3400	2400	2450
Overall dimensions for transport - BLOCK A (mm)	1670	885	2450
Overall dimensions for transport - BLOCK B (mm)	2477	1370	2450
Overall dimensions for transport - BLOCK C (mm)	1670	1285	2450

**Note:** Provide 200 mm clearance (minimum) below the unit for condensates siphons connection.

DESIGNATION		Unit	210	225
SPECIFICATIONS	Rated supply air flow rate	m <sup>3</sup> /h	16500	19500
	Min./Max. supply air flow rate	m <sup>3</sup> /h	9400/20000	12500/24000
	Treated air flow rate dehumidification	m <sup>3</sup> /h	11000	13000
	Min./Max. treated air flow rate	m <sup>3</sup> /h	9400/13000	12500/14500
	Dehumidification capacity on a heating base 100% recycling <sup>(2)</sup>	kg/h	53.8	62.5
	Dehumidification capacity on a heating base with 20% of FA <sup>(2)</sup>	kg/h	76.5	89.5
	Dehumidification capacity on a heating base with 50% of FA <sup>(2)</sup>	kg/h	110.5	130.1
	Thermodynamic COP on a heating base <sup>(2)</sup>	kW/kW	5.77	5.57
	Overall efficiency on a heating base <sup>(2)(6)</sup>	kW/kW	8.42	8.22
	Heat pipe recovery capacity <sup>(2)</sup>	kW	21.6	25.5
	Air-cooled condenser recovery capacity <sup>(2)</sup>	kW	72.7	83.01
	Water-cooled condenser recovery capacity on pool water <sup>(4)</sup>	kW	74.7	85.3
	Recommended total water flow rate per water-cooled condenser recovery pool <sup>(4)</sup>	m <sup>3</sup> /h	13.2	15
	Pressure drop, with water-cooled condenser for recovery on pool water <sup>(4)</sup>	mWC	2	2.5
	Hot water coil maximum capacity, 80/60°C, exchanger inlet at 10°C	kW	199.3	229.0
	Total cooling capacity in cooling cycle <sup>(3)</sup>	kW	60.8	68.1
Number of independent refrigeration circuits	U	2	2	
ELECTRICAL CONNECTION	Unit total electrical power installed (standard) <sup>(1)</sup>	kW	32.5	37.9
	Total rated/starting current (standard) <sup>(1)</sup>	A	47.3/147.6	55.4/161.4
FANS	<b>SUPPLY AIR</b>			
	Number of fans (standard)	u	2	2
	Installed power	kW	6.8	8.8
	Power absorbed at 300 Pa available for recovery	kW	4.42	6.02
	<b>EXHAUST AIR</b>			
	Number of fans	u	2	2
	Installed power	kW	5.94	5.94
	Absorbed/Installed electrical power with 300 Pa available for return air	kW	3.86	3.86
Average sound pressure level at 10 m ref. 2x10 <sup>-5</sup> in free field	dB(A)	47.4	47.3	
GENERAL	Filters efficiency		M5 / F7 / F9 <sup>(5)</sup>	M5 / F7 / F9 <sup>(5)</sup>
	Weight of block A (without options)	kg	290	290
	Weight of block B (without options)	kg	950	950
	Weight of block C (without options)	kg	460	460
	ETT unit weight without options	kg	1700	1700

(1) Excluding electrical resistors.

(2) Conditions: Recovery 28°C/65% RH; exterior -7°C/95% RH.


(3) Conditions: Recovery 29°C/70% RH; exterior +35°C/40% RH.

(4) Conditions: 28°C pool water; 28°C/65% RH return air


(5) ISO ePM10 50% (M5) / ISO ePM1 50% (F7), / ISO ePM1 80% (F9)

(6) Three-phase power supply 400V-50Hz + earth without neutral.


### Front view:

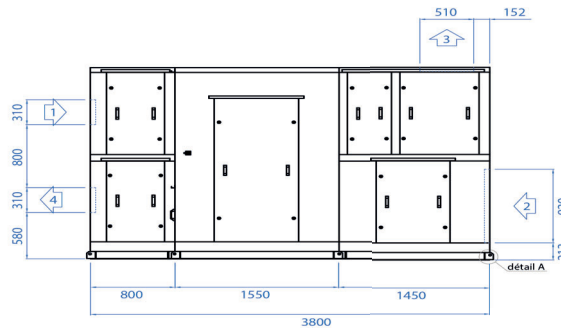

### Top view (fresh air/supply air):

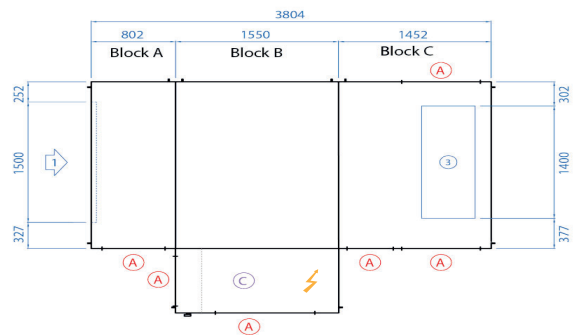

### Top view (return air/exhaust air):

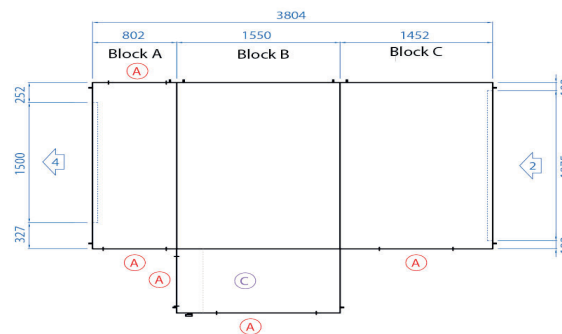

- ① Fresh air
- ② Return air
- ③ Supply air
- ④ Exhaust air
- (A) Access
- ⚡ Power supply
- (C) Technical section

	Length	Width	Height
Dimensions of assembled casing (mm)	3800	2875	2400
Overall dimensions for transport - BLOCK A (mm)	2145	835	2400
Overall dimensions for transport - BLOCK B (mm)	2952	1620	2400
Overall dimensions for transport - BLOCK C (mm)	2185	1485	2400

**Note:** Provide 200 mm clearance (minimum) below the unit to connect the condensate traps.

DESIGNATION		Unit	260	285
SPECIFICATIONS	Rated supply air flow rate	m <sup>3</sup> /h	24000	30000
	Min./Max. supply air flow rate	m <sup>3</sup> /h	14500/28500	17500/35000
	Treated air flow rate dehumidification	m <sup>3</sup> /h	16000	20000
	Min./Max. treated air flow rate	m <sup>3</sup> /h	14500/19000	17500/23000
	Dehumidification capacity on a heating base 100% recycling <sup>(2)</sup>	kg/h	81.7	90.1
	Dehumidification capacity on a heating base with 20% of FA <sup>(2)</sup>	kg/h	114.0	132.9
	Dehumidification capacity on a heating base with 50% of FA <sup>(2)</sup>	kg/h	162.5	197.1
	Thermodynamic COP on a heating base <sup>(2)</sup>	kW/kW	5.58	5.67
	Overall efficiency on a heating base <sup>(2)(6)</sup>	kW/kW	7.76	8.19
	Heat pipe recovery capacity <sup>(2)</sup>	kW	32.2	38.2
	Air-cooled condenser recovery capacity <sup>(2)</sup>	kW	108.9	122.5
	Water-cooled condenser recovery capacity on pool water <sup>(4)</sup>	kW	117.3	126.3
	Recommended total water flow rate per water-cooled condenser recovery pool <sup>(4)</sup>	m <sup>3</sup> /h	16.1	18.6
	Pressure drop, with water-cooled condenser for recovery on pool water <sup>(4)</sup>	mWC	2.8	3.6
	Hot water coil maximum capacity, 80/60°C, exchanger inlet at 10°C	kW	289.4	344.2
Total cooling capacity in cooling cycle <sup>(3)</sup>	kW	88.2	101.5	
Number of independent refrigeration circuits	U	2	2	
ELECTRICAL CONNECTION	Unit total electrical power installed (standard) <sup>(1)</sup>	kW	52.7	56.2
	Total rated/starting current (standard) <sup>(1)</sup>	A	73.1/192	81.4/230
FANS	<b>SUPPLY AIR</b>			
	Number of fans (standard)	u	3	3
	Installed power	kW	13.35	13.2
	Power absorbed at 300 Pa available for recovery	kW	8.67	9.03
	<b>EXHAUST AIR</b>			
	Number of fans	u	2	2
	Installed power	kW	8.90	8.80
	Absorbed/Installed electrical power with 300 Pa available for return air	kW	5.78	6.02
Average sound pressure level at 10 m ref. 2x10 <sup>-5</sup> in free field	dB(A)	49.2	47.1	
GENERAL	Filters efficiency		M5 / F7 / F9 <sup>(5)</sup>	M5 / F7 / F9 <sup>(5)</sup>
	Weight of block A (without options)	kg	420	420
	Weight of block B (without options)	kg	1505	1505
	Weight of block C (without options)	kg	605	605
	ETT unit weight without options	kg	2530	2530

(1) Excluding electrical resistors.

(2) Conditions: Recovery 28°C/65% RH; exterior -7°C/95% RH.

(3) Conditions: Recovery 29°C/70% RH; exterior +35°C/40% RH.


(4) Conditions: 28°C pool water; 28°C/65% RH return air

(5) ISO ePM10 50% (M5) / ISO ePM1 50% (F7), / ISO ePM1 80% (F9)


(6) Three-phase power supply 400V-50Hz + earth without neutral.




## Front view:

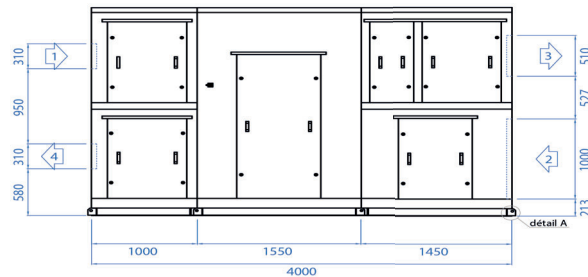

## Top view (fresh air/supply air):

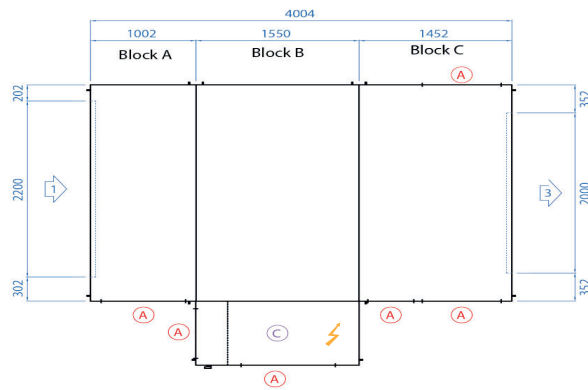

## Top view (return air/exhaust air):

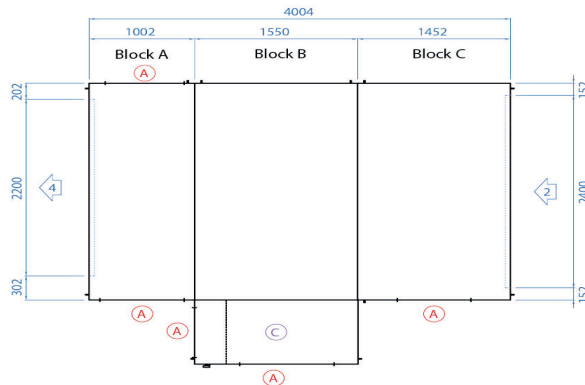


- ① Fresh air
- ② Return air
- ③ Supply air
- ④ Exhaust air
- Ⓐ Access
- ⚡ Power supply
- Ⓒ Technical section

	Length	Width	Height
Dimensions of assembled casing (mm)	4000	3500	2600
Overall dimensions for transport - BLOCK A (mm)	2770	1035	2600
Overall dimensions for transport - BLOCK B (mm)	3577	1620	2600
Overall dimensions for transport - BLOCK C (mm)	2770	1485	2600


**Note:** Provide 200 mm clearance (minimum) below the unit for condensates siphons connection.

# Airflow arrangements

## Arrangement A

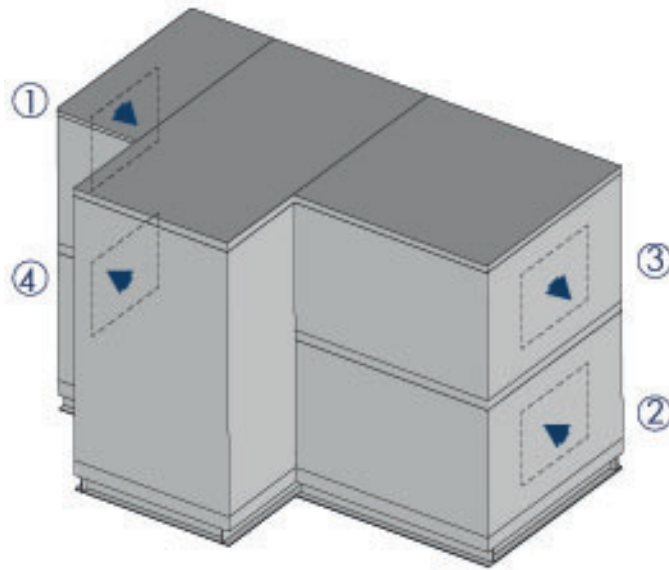

## Arrangement B

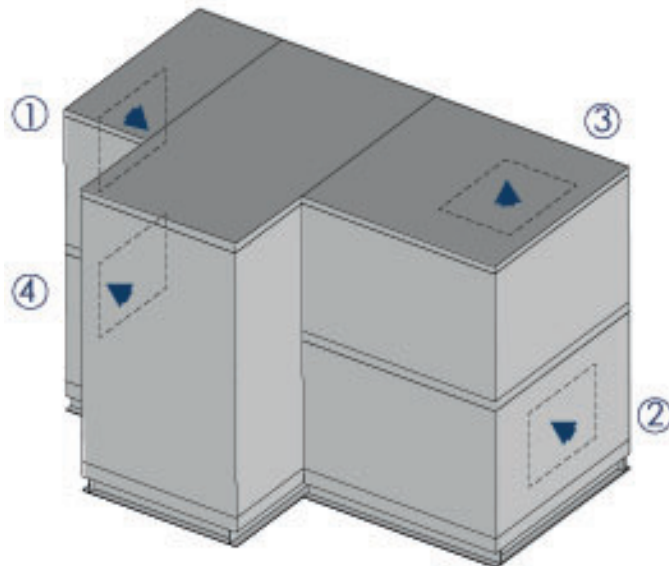

① Fresh air ② Return air ③ Supply air ④ Exhaust air

# Auxiliaries: Hot water coils


## Available capacities (en kW)

Total capacity (kW)	Current (A)	1st stage	2nd stage	107	109	110	125	160	185	210	225	260	285	Weight (kg)
9	13	3	6	•	•	•	•	•	•	•	•	•	•	7.8
12	17.3	3	9	•	•	•	•	•	•	•	•	•	•	8.4
15	21.7	6	9	•	•	•	•	•	•	•	•	•	•	9.2
18	26	6	12	•	•	•	•	•	•	•	•	•	•	10
21	30.3	6	15	•	•	•	•	•	•	•	•	•	•	10.7
24	34.6	9	15	•	•	•	•	•	•	•	•	•	•	11.3
27	39	9	18	•	•	•	•	•	•	•	•	•	•	13.9
30	43.3	12	18	•	•	•	•	•	•	•	•	•	•	14.7
33	47.6	12	21	•	•	•	•	•	•	•	•	•	•	13.8
36	52	15	21	•	•	•	•	•	•	•	•	•	•	14.5
39	56.3	15	24		•	•	•	•	•	•	•	•	•	15.2
42	60.6	18	24		•	•	•	•	•	•	•	•	•	17.8
45	65	18	27			•	•	•	•	•	•	•	•	18.6
48	69.3	21	27				•	•	•	•	•	•	•	17.7
54	77.9	21	33				•	•	•	•	•	•	•	21
60	86.6	21	39					•	•	•	•	•	•	20.8
63	90.9	27	36					•	•	•	•	•	•	25
72	103.9	27	45					•	•	•	•	•	•	23.8
81	116.9	27	54						•	•	•	•	•	31.5

**Note:** An additional coil can be mounted in the supply air duct or on the fresh air inlet for higher performances. Please consult us.

# Auxiliaries: Hot water coils

## Schematic diagram

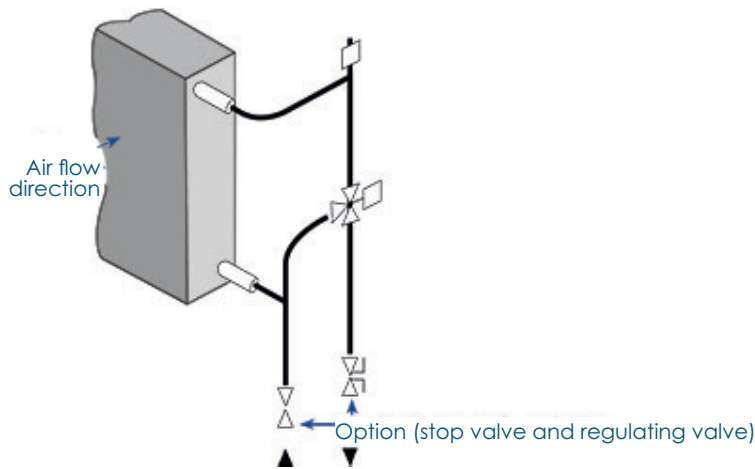

## Connections and weights

	Unit	107	109	110	125	160	185	210	225	260	285
Customer connection diameter	mm	33/42	40/49	40/49	40/49	50/60	50/60	50/60	50/60	66/76	66/76
Coil + 3WV with water	kg	45	71	71	71	110	110	133	133	220	220

## Capacities and pressure drops for an air inlet temperature on coils of +10°C (STANDARD)

		Unit	107	109	110	125	160	185	210	225	260	285
Water regime 80/60°C	Max. power	kW	68	91	98	111	146	173	199	229	289	344
	Max. flow rate	m³/h	3.0	4.0	4.3	4.9	6.4	7.6	8.8	10.1	12.7	15.1
	Coil + 3WV pressure drop	mWC	4.2	3.4	3.9	5.0	2.8	4.0	3.2	4.2	4.2	5.9
Water regime 50/40°C	Max. power	kW	39	53	56	64	83	99	114	132	167	199
	Max. flow rate	m³/h	3.4	4.6	4.9	5.6	7.2	8.6	9.9	11.4	14.5	17.2
	Coil + 3WV pressure drop	mWC	5.6	4.6	5.2	6.7	3.7	5.3	4.3	5.6	5.6	7.9

## Capacities and pressure drops for an air inlet temperature on coils of +10°C (SIMMETRIC UNIT)

		Unit	107	109	110	125	160	185	210	225	260	285
Water regime 80/60°C	Max. power	kW	61	81	87	99	130	154	177	204	258	306
	Max. flow rate	m³/h	2.7	3.6	3.8	4.4	5.7	6.8	7.8	9.0	11.3	13.5
	Coil + 3WV pressure drop	mWC	3.6	3.1	3.5	4.6	2.5	3.6	2.9	3.9	3.7	5.2
Water regime 50/40°C	Max. power	kW	35	47	50	57	74	88	102	117	149	177
	Max. flow rate	m³/h	3.0	4.1	4.3	5.0	6.5	7.7	8.8	10.2	12.9	15.4
	Coil + 3WV pressure drop	mWC	4.9	4.2	4.7	6.1	3.3	4.7	4.0	5.2	4.9	6.9

## Optional : flow shut-off valve and return TA control valve

		Unit	107	109	110	125	160	185	210	225	260	285
Water regime 80/60°C	Stop and TA valves pressure drop (3-turn opening)	mWC	1	1	1.2	1.4	0.9	1.2	1.6	2.1	0.4	0.6
Water regime 50/40°C	Stop and TA valves pressure drop (3-turn opening)	mWC	1.3	1.3	1.4	1.8	1.1	1.5	2.1	2.6	0.5	0.7

# Auxiliaries: Hot water coils

## Capacities and pressure drops for an air inlet temperature on coils of +20°C (STANDARD)

		Unit	107	109	110	125	160	185	210	225	260	285
Water regime 80/60°C	Max. power	kW	57	76	82	93	121	144	166	192	242	288
	Max. flow rate	m³/h	2.5	3.4	3.6	4.1	5.3	6.3	7.3	8.4	10.6	12.7
	Coil + 3WV pressure drop	mWC	3.0	2.6	2.8	3.6	2.1	2.8	2.7	3.2	3.4	4.5
Water regime 50/40°C	Max. power	kW	28	37	40	46	59	70	82	93	119	141
	Max. flow rate	m³/h	2.5	3.2	3.5	4.0	5.1	6.1	7.1	8.1	10.4	12.3
	Coil + 3WV pressure drop	mWC	3.0	2.4	2.8	3.7	2.2	3.1	2.4	3.1	3.1	4.4

## Capacities and pressure drops for an air inlet temperature on coils of +20°C (SIMMETRIC UNIT)


		Unit	107	109	110	125	160	185	210	225	260	285
Water regime 80/60°C	Max. power	kW	50	68	73	83	108	128	148	170	215	256
	Max. flow rate	m³/h	2.2	3.0	3.2	3.6	4.7	5.6	6.5	7.5	9.5	11.3
	Coil + 3WV pressure drop	mWC	2.7	2.4	2.5	3.3	1.8	2.5	2.5	3.0	3.1	4.0
Water regime 50/40°C	Max. power	kW	25	33	36	41	52	62	73	83	106	126
	Max. flow rate	m³/h	2.2	2.9	3.1	3.6	4.5	5.4	6.3	7.2	9.2	10.9
	Coil + 3WV pressure drop	mWC	2.7	2.2	2.6	3.3	2.0	2.8	2.2	2.9	2.8	3.9

## Optional : flow shut-off valve and return TA control valve

		Unit	107	109	110	125	160	185	210	225	260	285
Water regime 80/60°C	Stop and TA valves pressure drop (3-turn opening)	mWC	1	1	1.2	1.4	0.9	1.2	1.6	2.1	0.4	0.6
Water regime 50/40°C	Stop and TA valves pressure drop (3-turn opening)	mWC	1.3	1.3	1.4	1.8	1.1	1.5	2.1	2.6	0.5	0.7

# Water condenser

## Schematic diagram

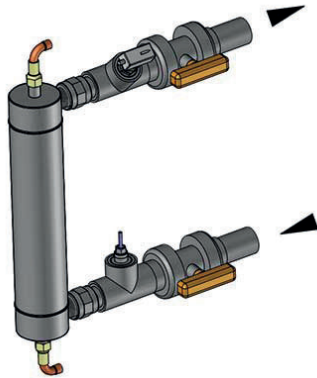

This equipment allows heat to be transferred to pool water when the desired room air temperature is reached. The water-cooled condenser is made of 316L stainless steel and features a freon 3-way valve and a water flow regulator with automatic reset (for chlorine water treatment only)

For other water treatments, use a titanium exchanger.

Stop valves are available as an option.


	Unit	107	109	110	125	160	185
Quantity		1	1	1	1	1	1
<b>Total heating capacity</b>	<b>kW</b>	<b>24.8</b>	<b>32.3</b>	<b>36.8</b>	<b>42.2</b>	<b>55.6</b>	<b>63.4</b>
Total flow rate	m <sup>3</sup> /h	4.5	5.8	6.6	7.5	8.1	9.3
Inlet temperature	°C	28	28	28	28	28	28
Outlet temperature	°C	33	33	33	33	34	34
Exchanger pressure drop, per condenser	mWC	1	1.6	2	2.5	2.8	3.6
Total weight	kg	26.1	36.2	36.2	36.2	40	40
Connection diameter	mm	63	63	63	63	63	63

	Unit	210	225	260	285
Quantity		2	2	2	2
<b>Total heating capacity</b>	<b>kW</b>	<b>74.7</b>	<b>85.3</b>	<b>117.3</b>	<b>126.3</b>
Total flow rate	m <sup>3</sup> /h	13.2	15	16.1	18.6
Inlet temperature	°C	28	28	28	28
Outlet temperature	°C	33	33	34	34
Exchanger pressure drop, per condenser	mWC	2	2.5	2.8	3.6
Total weight	kg	70.3	70.3	78	78
Connection diameter	mm	75	75	75	75



# Connections : Hot water coil & water condenser

## Functional Schematic - Front View

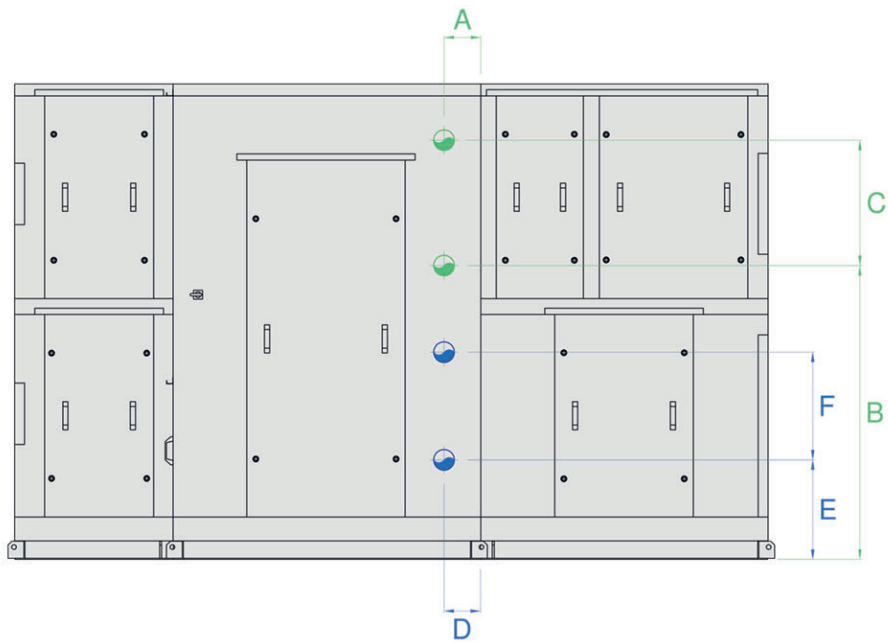

Connection interface "Auxiliary : hot water coil" / Connection interface "Water condenser"

	Unit	107	109	110	125	160	185	210	225	260	285
A	mm	155	154	154	154	155	155	186	186	186	186
B	mm	1213	1274	1274	1274	1390	1390	1374	1374	1483	1483
C	mm	135	155	155	155	562	562	538	538	633	633
D	mm	127	127	127	127	127	127	144	144	144	144
E	mm	309	309	309	309	309	309	502	502	502	502
F	mm	544	544	544	544	544	544	544	544	544	544

# Sound level\* at supply/exhaust

## Frequency band spectrum

### On supply air side

	FREQUENCY BAND		63	125	250	500	1000	2000	4000	8000	Overall level Lw (dB(A))
	Supply air flow rate (m <sup>3</sup> /h) ▼	Treated air flow rate (m <sup>3</sup> /h) ▼									
107	6000	4000	54.2	61.2	71.9	77.8	83.8	83.5	80.5	74.2	88.3
109	7500	5000	54.9	63.4	73.4	79.9	82.4	81.0	77.7	75.1	87.1
110	8250	5500	55.4	63.9	73.9	80.4	82.9	81.5	78.2	75.6	87.6
125	9750	6500	51.7	64.5	72.6	79.2	83.0	85.0	81.1	76.9	89.0
160	12000	8000	57.9	66.4	76.4	82.9	85.4	84.0	80.7	78.1	90.1
185	15000	10000	58.4	66.9	76.9	83.4	85.9	84.5	81.2	78.6	90.6
210	16500	11000	58.4	66.9	76.9	83.4	85.9	84.5	81.2	78.6	90.6
225	19500	13000	54.7	70.9	74.8	83.5	83.7	82.4	80.3	73.9	89.1
260	24000	16000	56.0	68.8	76.9	83.5	87.3	89.3	85.4	81.2	93.3
285	30000	20000	56.5	72.7	76.6	85.3	85.5	84.2	82.1	75.7	90.8

### On exhaust air side

	FREQUENCY BAND		63	125	250	500	1000	2000	4000	8000	Overall level Lw (dB(A))
	Supply air flow rate (m <sup>3</sup> /h) ▼	Treated air flow rate (m <sup>3</sup> /h) ▼									
107	6000	4000	49.2	61.0	74.3	79.7	87.4	87.2	85.0	78.3	91.9
109	7500	5000	49.2	61.0	74.3	79.7	87.4	87.2	85.0	78.3	92.0
110	8250	5500	53.7	60.7	71.4	77.3	83.3	83.0	80.0	73.7	87.8
125	9750	6500	54.2	61.2	71.9	77.8	83.8	83.5	80.5	74.2	88.3
160	12000	8000	55.4	63.9	73.9	80.4	82.9	81.5	78.2	75.6	87.6
185	15000	10000	51.7	64.5	72.6	79.2	83.0	85.0	81.1	76.9	89.0
210	16500	11000	56.7	63.7	74.4	80.3	86.3	86.0	83.0	76.7	90.8
225	19500	13000	57.2	64.2	74.9	80.8	86.8	86.5	83.5	77.2	91.3
260	24000	16000	54.2	67.0	75.1	81.7	85.5	87.5	83.6	79.4	91.5
285	30000	20000	54.7	70.9	74.8	83.5	83.7	82.4	80.3	73.9	89.1

\*Lw: sound power level (dB(A))

# Sound level\* at fresh air intake/return

## Frequency band spectrum

### At fresh air inlet

	FREQUENCY BAND		63	125	250	500	1000	2000	4000	8000	Overall level Lw (dB(A))
	Supply air flow rate (m <sup>3</sup> /h) ▼	Treated air flow rate (m <sup>3</sup> /h) ▼									
107	6000	4000	49.7	62.1	74.2	80.0	86.6	86.1	84.2	75.8	91.1
109	7500	5000	51.5	62.7	74.5	80.1	86.6	86.1	84.2	75.9	91.1
110	8250	5500	54.4	62.7	72.5	78.0	82.6	82.0	79.3	71.6	87.2
125	9750	6500	53.9	63.1	72.3	78.1	83.1	82.5	80.0	72.2	87.7
160	12000	8000	56.4	65.6	75.0	81.0	82.3	80.7	77.7	73.6	87.3
185	15000	10000	54.6	66.2	74.4	80.1	82.5	84.0	80.5	74.8	88.5
210	16500	11000	57.4	65.7	75.5	81.0	85.6	85.0	82.3	74.6	90.2
225	19500	13000	57.0	67.3	75.1	80.9	86.1	85.5	82.9	74.7	90.6
260	24000	16000	54.7	68.2	75.8	82.0	84.9	86.5	83.2	77.3	90.9
285	30000	20000	55.4	71.8	75.4	83.6	83.2	81.8	79.9	71.6	88.8


### On return air side

	FREQUENCY BAND		63	125	250	500	1000	2000	4000	8000	Overall level Lw (dB(A))
	Supply air flow rate (m <sup>3</sup> /h) ▼	Treated air flow rate (m <sup>3</sup> /h) ▼									
107	6000	4000	48.7	62.3	73.1	76.9	74.0	74.3	71.9	68.7	81.6
109	7500	5000	52.5	63.4	73.9	77.5	74.1	74.1	71.5	70.8	82.1
110	8250	5500	52.8	63.7	72.9	77.4	72.2	72.9	71.6	70.2	81.4
125	9750	6500	49.2	64.0	71.7	74.6	72.4	74.3	75.3	71.1	81.4
160	12000	8000	55.8	66.2	75.4	79.9	74.5	75.0	73.8	72.8	83.8
185	15000	10000	55.7	66.7	75.6	80.1	74.9	75.8	74.9	73.4	84.2
210	16500	11000	55.8	66.7	75.9	80.4	75.2	76.0	74.6	73.2	84.4
225	19500	13000	52.8	68.9	73.8	74.7	74.8	76.1	75.5	67.3	82.4
260	24000	16000	53.3	68.4	75.6	78.2	76.5	78.5	79.8	75.6	85.5
285	30000	20000	54.5	71.2	74.9	74.3	76.2	77.4	77.1	68.2	83.6

\*Lw: sound power level (dB(A))



# Installation accessories : Feet

Fixed aluminium foot  
Unit weight: 1 kg

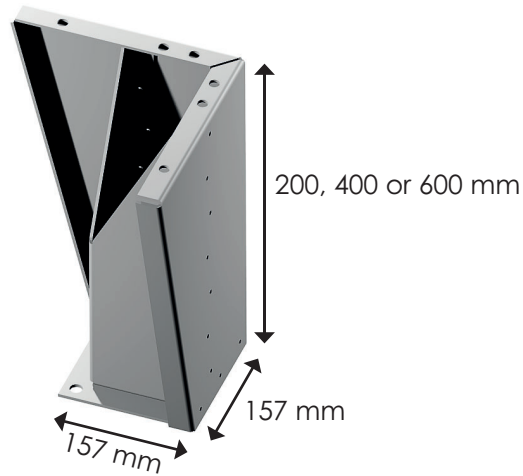

Unit	107	109	110	125	160	185	210	225	260	285
Number feet (Packaged)	8	8	8	8	n/a	n/a	n/a	n/a	n/a	n/a
Number feet (3-block)	12	12	12	12	12	12	12	12	14	14



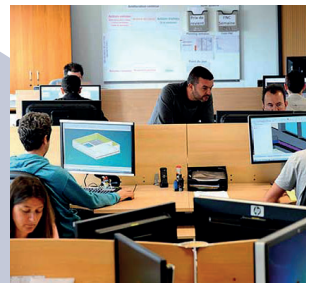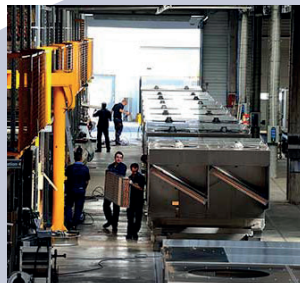

Reference : MARK-BRO\_43-EN\_E

ETT - Route de Brest - BP26  
29830 Ploudalmézeau - France  
Tel.: +33 (0)2 98 48 14 22  
Fax: +33 (0)2 98 48 09 12  
Export Contact: +33 (0)2 98 48 00 70  
ETT Services: +33 (0)2 98 48 02 22

[www.ett-hvac.com](http://www.ett-hvac.com)